



Surface Finish to be finished to NRA (Roads Authority) Specification/Requirement or by Local Landowner, which ever applies

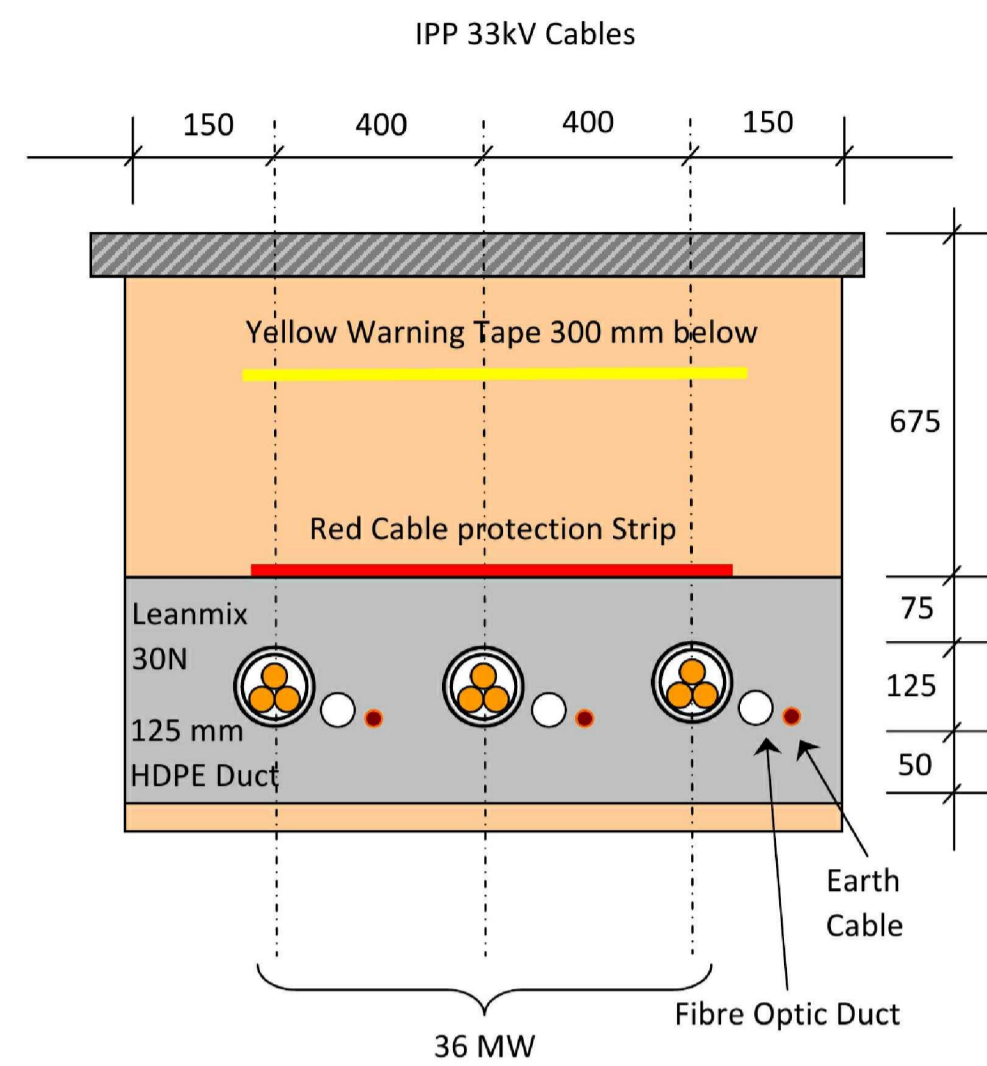


Section "X-X" - 3 No. 33kV Cable Ducts (36MW) - In Road - Between Turbine T1-T12 & Proposed Substation

Surface Finish to be finished to NRA (Roads Authority) Specification/Requirement or by Local Landowner, which ever applies

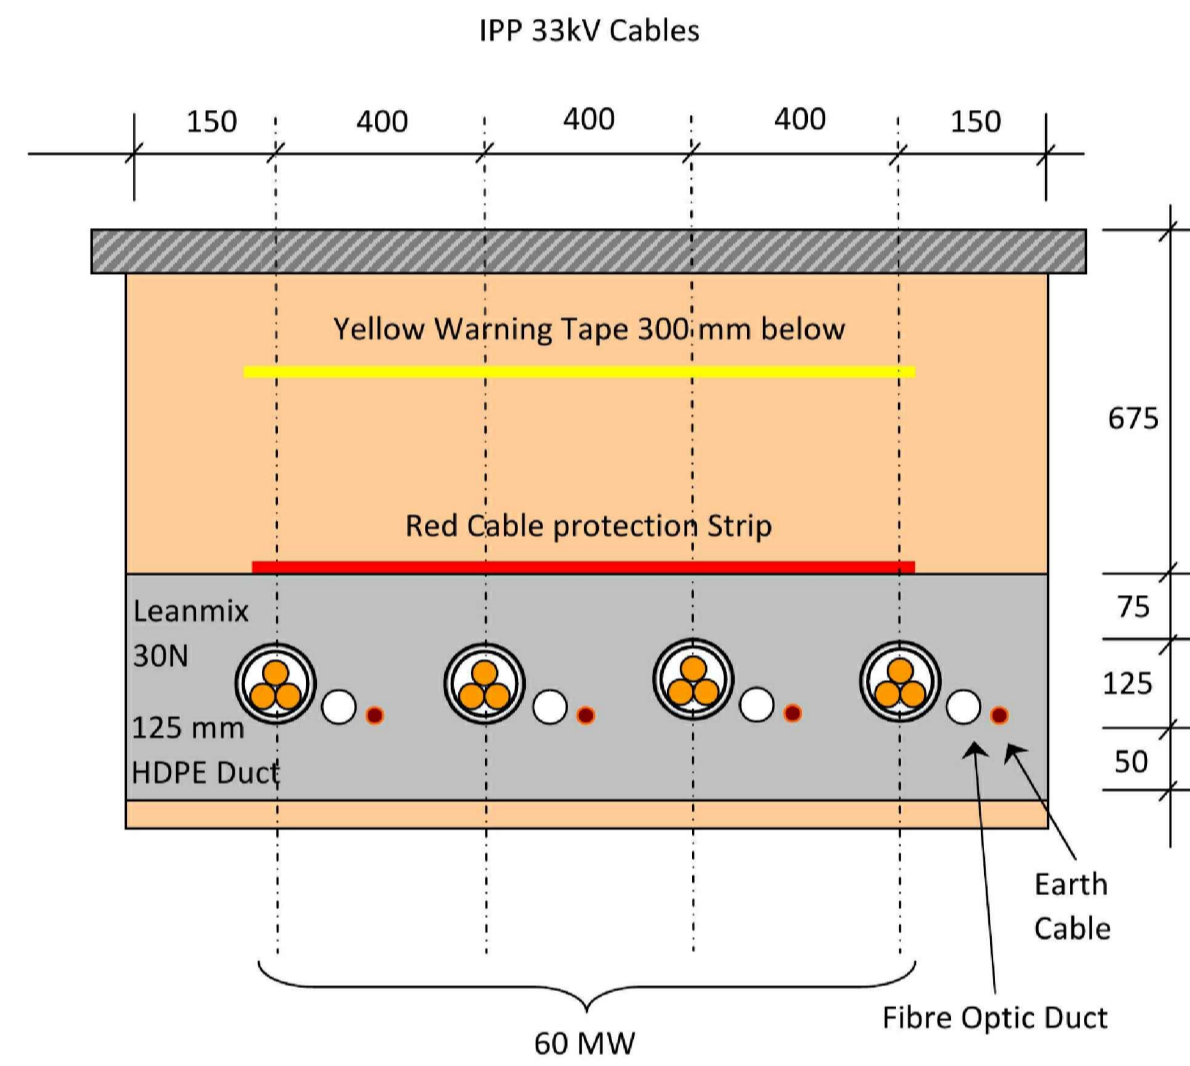

Section "Y-Y" - 4 No. 33kV Cable Ducts (60MW) - In Road - Between Turbine T13-T32 & Proposed Substation

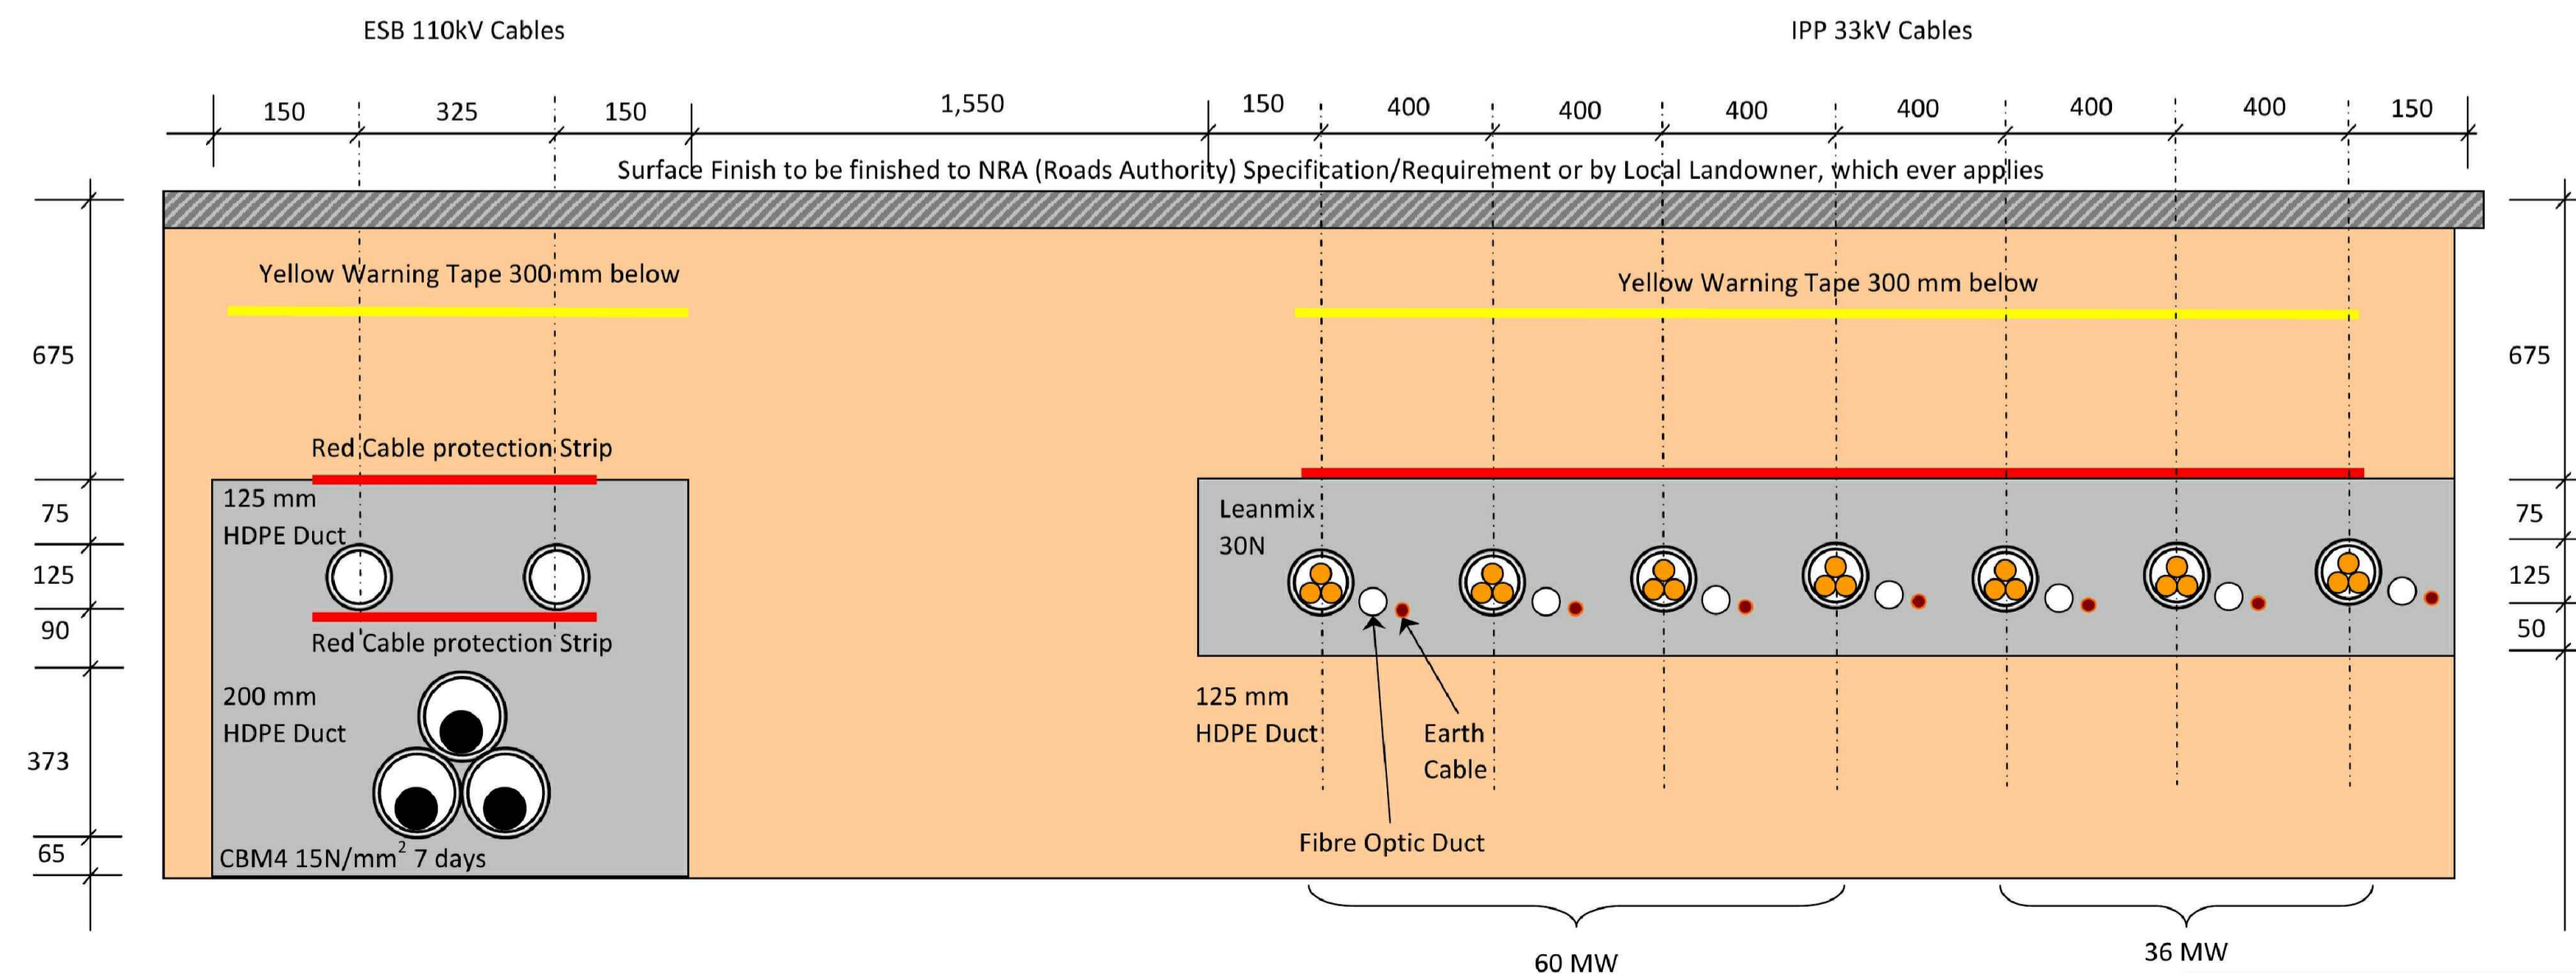

Section "Z-Z" - 7 No. 33kV Cable Ducts (96MW) & 1 No. 110kV Trafoil Arrangement - In Road - Proposed Substation Access Road

Notes

1. FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
2. ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
3. ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
4. ALL LEVELS REFER TO ORDINANCE DATUM (MALIN HEAD).

rev.	modifications	by	chkd	date

file

client	GREEN WIND ENERGY GROUP.		
project	YELLOW RIVER WIND FARM, COUNTY OFFALY.		
stage	PLANNING - SECTION 2		
title	110 & 33kV UNDERGROUND CABLE TRENCH DETAILS		
scale	NOT TO SCALE		
surveyed	drawn	checked	date
	D.H	J.H	April 2014

© COPYRIGHT OF
JENNINGS O'DONOVAN & PARTNERS CONSULTING ENGINEERS,
 FINISKLIN, SLIGO, IRELAND.
 TEL. (0035371) 9161416.
 FAX. (0035371) 9161080.
 Email. info@jodireland.com
 Web. www.jodireland.com

Job Ref:	Drawing Ref:	Revision:
4909	4909 - PL - S2 - 502	